


## 2020 NEC Changes

### 230.85 Exterior Emergency Disconnect(s)

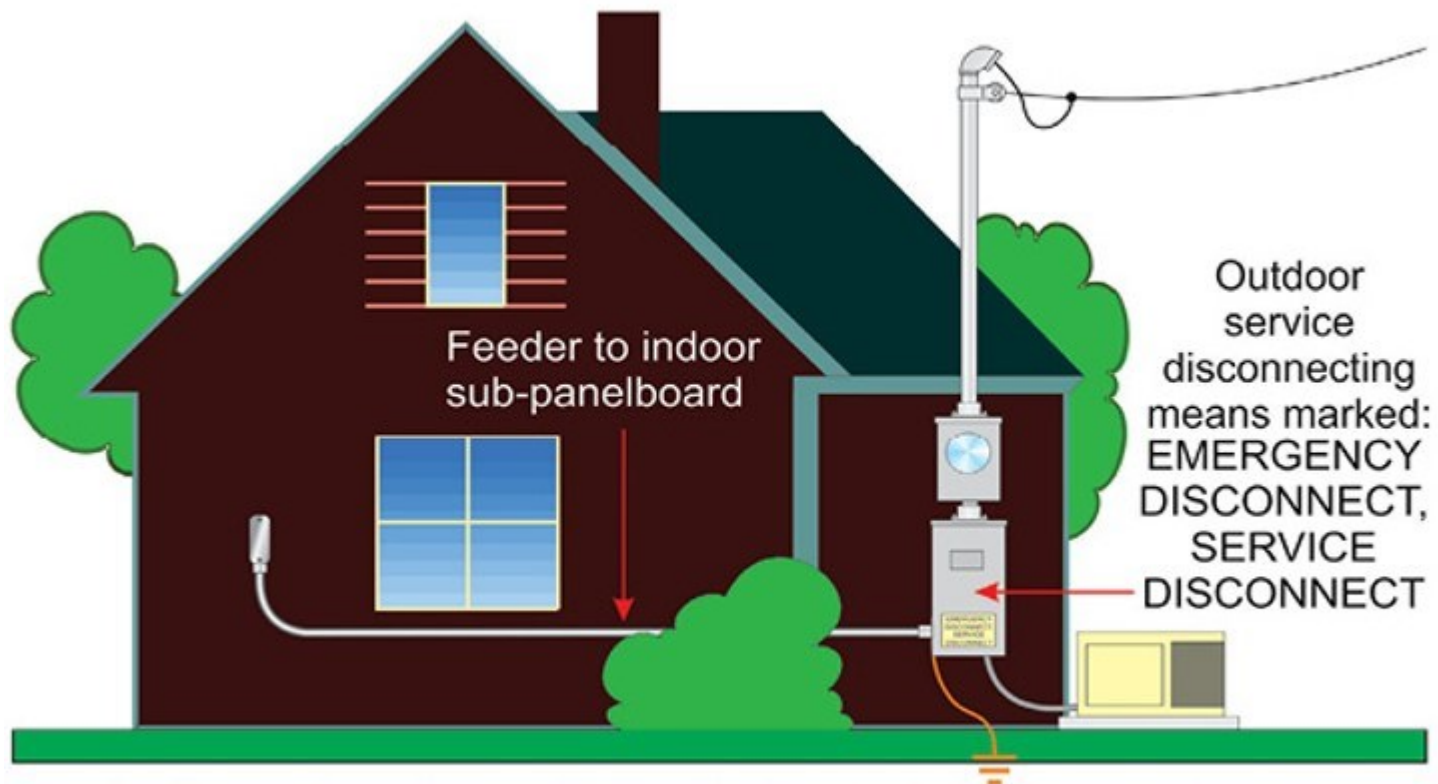

For dwellings, all service conductors to terminate in disconnecting means having a short-circuit current rating equal to or greater than the available fault current, installed in a **readily accessible outdoor location**